



PUBLIC WORKS
Engineering

DATE: November 13, 2025

TO: PAUL ZACHARY,
PUBLIC WORKS DEPUTY
DIRECTOR

FROM: ^{HAS} H. SOMDECERFF,
PUBLIC WORKS DESIGN
MANAGER

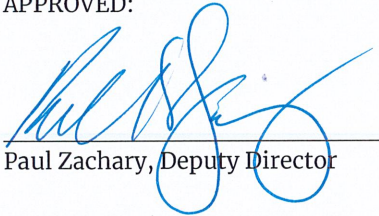
The Specification Review Committee recommends and asks the Public Works Deputy Director to approve the following:

1. Approve Modification to Division 210.1 - Conduit.
Summary of change: Change wall thickness to minimum 1/2" and Change Conduit ID to Minimum Conduit ID in table.

Please call Marqua Jimmerson at (918) 596-7355 If you have any questions.

Thank you,

APPROVED:


Paul Zachary, Deputy Director

11.19.25
Date

Cc: Public Works Engineering Services Specification Review Committee

foundry's local representative's yard. Such testing shall be at manufacturer's expense.

PART 210 – CONDUIT

- 210.1 Where conduit (also known as tunnel liner or pipe sleeve), 6" or larger, is specified or required, it shall be steel pipe, and be in accordance with AWWA C200, 1/2" wall thickness.

Conduit shall be sized according to the following:

Carrier Pipe		Minimum Conduit, ID
Water	Sanitary Sewer	
6"	6"	18"
8"	8"	20"
	10"	22"
12"		24"
	12"	26"
	15"	28"
16"		30"
	16"	32"
	18"	32"
24"	24"	42"
30"	30"	48"
36"	36"	54"
42"		60"
	42"	62"
	48"	68"