


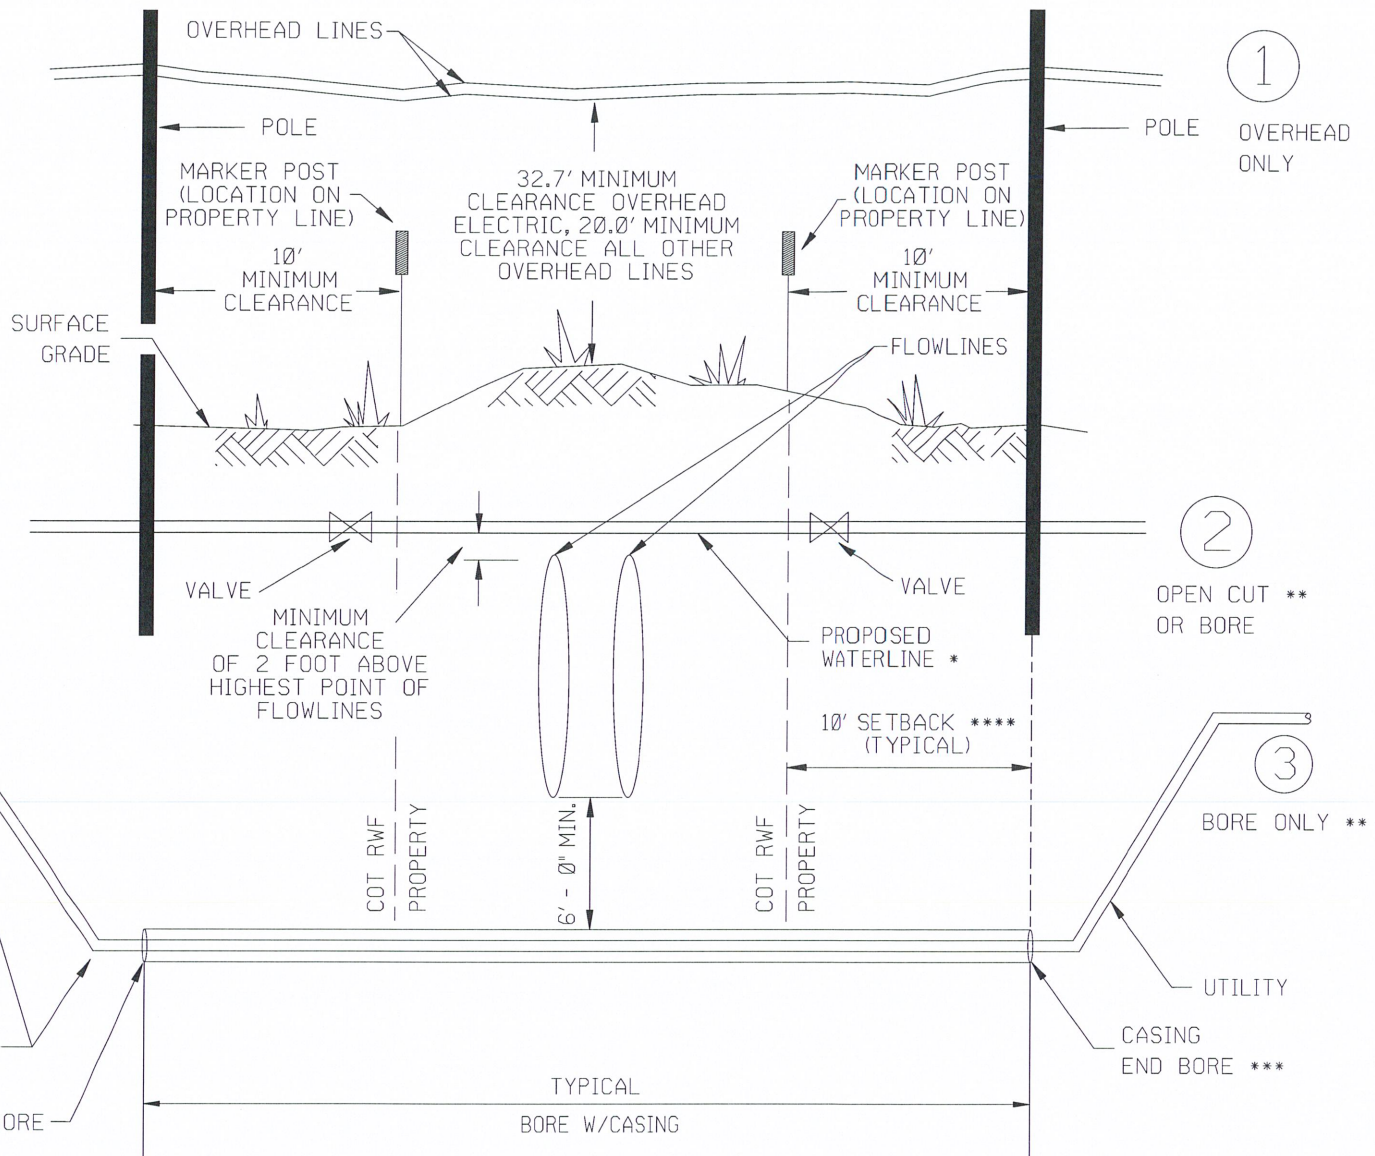

* CROSSING ABOVE THE RAW WATER FLOWLINES (RWF) IS FOR POTABLE WATERLINE ONLY

** PUSHING/RECEIVING PITS MUST BE A MINIMUM OF 10' FROM PROPERTY LINE

*** CASING AS REQUIRED BY CITY OF TULSA. VENT PIPE AS REQUIRED

**** OVERHEAD POLE OR GUYWIRE MUST BE A MINIMUM OF 10' FROM PROPERTY LINE

N.T.S.

OPTIONS

- ☐ 1 OVERHEAD ONLY
- ☐ 2 OPEN CUT OR BORE
- ☐ 3 BORE ONLY

TYPICAL UTILITY CROSSING OF RAW WATER FLOWLINES (RWF)

CITY OF TULSA, OKLAHOMA
ENGINEERING SERVICES DEPARTMENT

DRAWN BY: R.M.G.

CHECKED BY: *tg*

DATE: AUGUST 2025

APPROVED

Zom

NOT TO SCALE

STANDARD NO. 509