



PUBLIC WORKS
Engineering

DATE: July 28, 2026

TO: PAUL ZACHARY,
PUBLIC WORKS DEPUTY
DIRECTOR

FROM: H. SOMDECERFF,
PUBLIC WORKS DESIGN
MANAGER


The Specification Review Committee recommends and asks the Public Works Deputy Director to approve the following:

1. Approve Modification to Standard Detail 529- 6" Meter Standard and Vault Assembly.
Summary of change:
 - Added "or Approved Equal" to Neenah R6663-NH 30"x 48" Lid with Cast Iron Frame.
 - In Note 1 changed Engineering Services Department to The City of Tulsa.
 - In Note 3 changed Engineering Services Department to The City of Tulsa.

Please call Marlene Segura at (918) 596-7355 If you have any questions.

Thank you,

APPROVED:

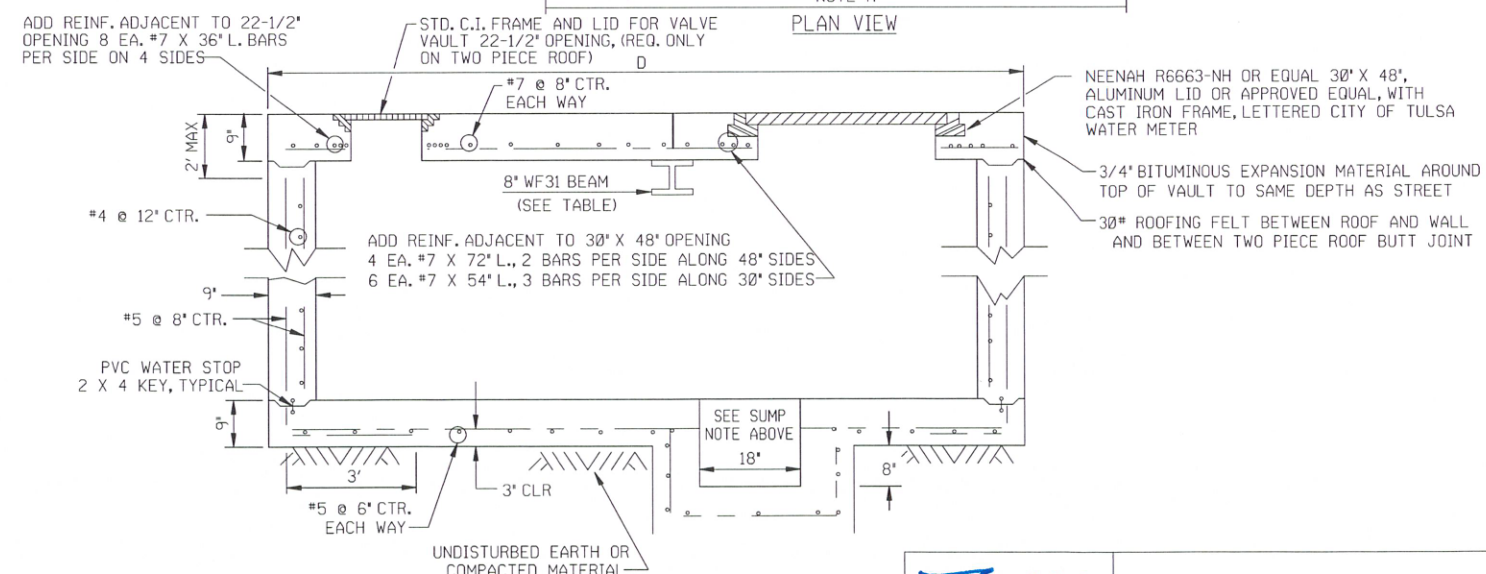

Paul Zachary, Deputy Director


Date

Cc: Public Works Engineering Services Specification Review Committee



- | METER | A | B | C | D | REMARKS |
|---|---------|-------|--------|---------|--|
| 6" TURBINE METER | 27" | 4'-2" | 6'-0" | 10'-10" | |
| 6" COMPOUND METER | 33" | 3'-8" | 5'-10" | 10'-0" | WITHOUT TEE |
| 6" NEPTUNE PROTECTUS III FIRE FLOW
METER W/STRAINER (FS) | 45" | 3'-8" | 6'-6" | 12'-4" | W/ FIRE SERVICE TURBINE
AND VAULT COVER IN 2/HALVES
W/4 LIFTING HOOKS EA.
8' WF 31 BEAM |
| 6" INVENSYS FIRELINE T.M. | 45" | 3'-8" | 6'-6" | 12'-4" | |
| 6" TURBINE METER FIRE SERVICE | 44-7/8" | 4'-2" | 6'-0" | 12'-4" | |
| | | | | | |



REVISION	BY	DATE

STD. 529